


ELEVATION

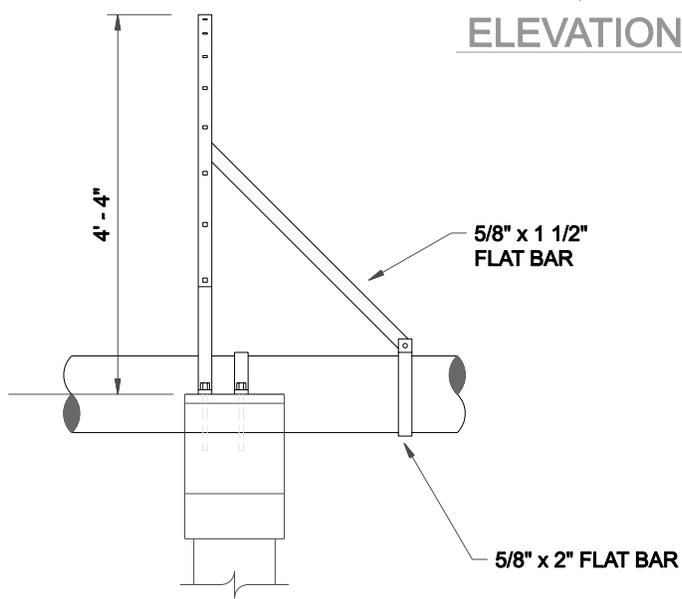

SIDE VIEW

NOTES:

1. FAN GUARDS SHALL BE PLACED AT EACH END OF CANAL CROSSING.
2. FAN GUARD AND ALL MOUNTING BRACKETS TO BE HOT DIP GALVANIZED AND MOUNTING HARDWARE TO BE STAINLESS STEEL.
3. 1/2" THICK NEOPRENE PAD TO INSULATE PIPE FROM CONTACT WITH ALL MOUNTING HARDWARE, FAN GUARD HARDWARE, AND CONCRETE SURFACES.

LBPH INC. - CADD FILE NAME: L:\CADD-DETAILS\SLC\SLC-G19.DWG



**ST. LUCIE COUNTY
WATER & WASTEWATER
CONSTRUCTION STANDARDS**

FAN GUARD DETAIL