



STANDARD SIDEWALK

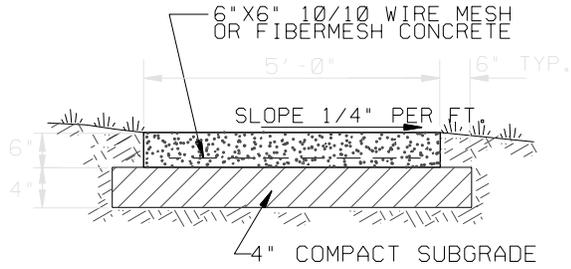

DRIVEWAY SIDEWALK

GENERAL CONSTRUCTION NOTES:

1. CONCRETE STRENGTH TO BE 2,500 P.S.I. AT 28 DAYS.
2. TOOLED DUMMY CONTRACTION JOINTS EVERY 5' (TYPE 'B' JOINTS) OR MATCH EXISTING.
3. EXPANSION JOINTS W/PREMOLDED FILLER AT 100' O/C (TYPE 'C' JOINTS)
4. SUBBASE TO BE 50 F.B.V. 98% DENSITY PER ASTM D-1557.
5. WHERE APPLICABLE, THE LOCAL MUNICIPALITY SIDEWALK DETAIL WILL GOVERN.

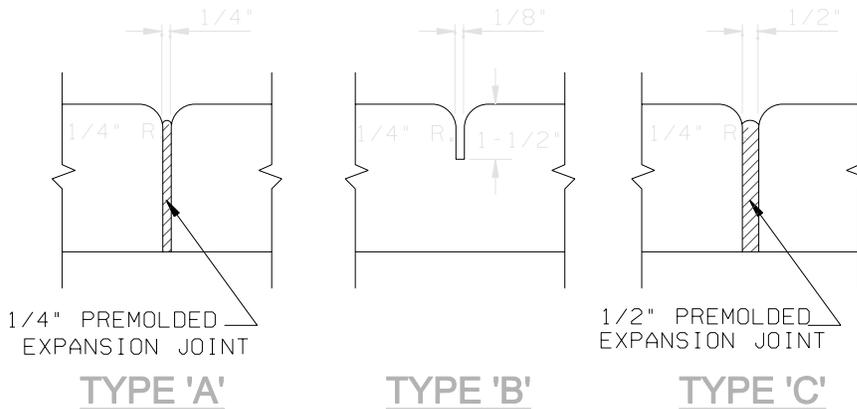

- TYPE 'A' AT P.C. & P.T. OF CURVES AND AT JUNCTION OF EXISTING AND NEW SIDEWALKS
- TYPE 'B' 5'-0" CENTER TO CENTER ON NEW SIDEWALKS
- TYPE 'C' WHERE NEW SIDEWALK ABUTS CONCRETE CURBS, DRIVEWAY AND SIMILAR STRUCTURES

LBPH, INC. - CADD FILE NAME: L:\CAD-DRAWINGS\SLC\SLC-G23.DWG



**ST. LUCIE COUNTY
WATER & WASTEWATER
CONSTRUCTION STANDARDS**

SIDEWALK DETAILS