


FITTING TYPE

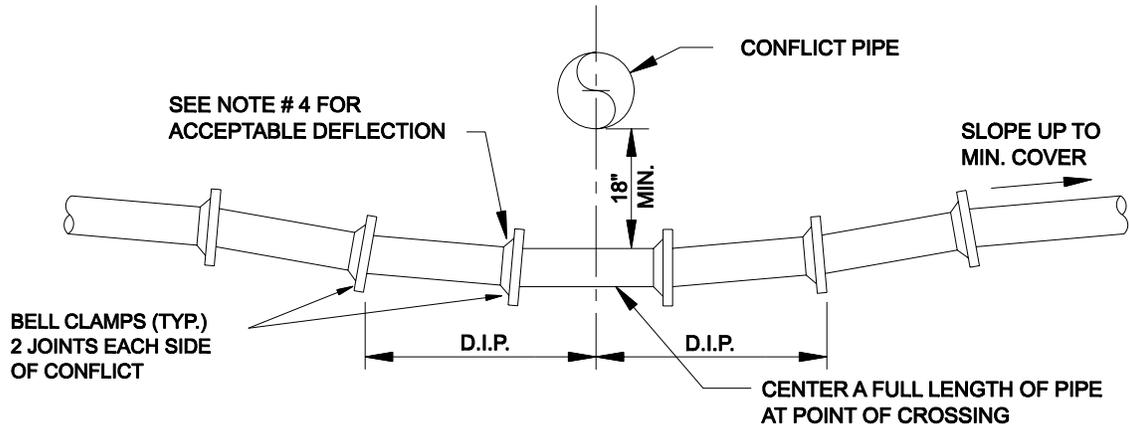

DEFLECTION TYPE

NOTES:

1. THESE METHODS ARE TO BE USED WHEN INSUFFICIENT COVER EXISTS TO ALLOW PRESSURE PIPE TO CROSS CONFLICT PIPE WITH 6" VERTICAL SEPARATION AND MAINTAIN 30" COVER TO FINISHED GRADE.
2. FITTINGS SHALL BE RESTRAINED WITH RETAINER GLANDS AND THRUST BLOCKS.
3. THE DEFLECTION TYPE CROSSING IS PREFERRED.
4. DO NOT EXCEED 75% OF MANUFACTURER'S RECOMMENDED MAXIMUM JOINT DEFLECTION.

LBFF INC. - CADD FILE NAME: L:\CAD-DETAILS\SLC\SLC-G6.DWG



ST. LUCIE COUNTY
WATER & WASTEWATER
CONSTRUCTION STANDARDS

PRESSURE PIPE CONFLICT DETAIL

DRAWING NUMBER: G-5