


DETAIL "A"

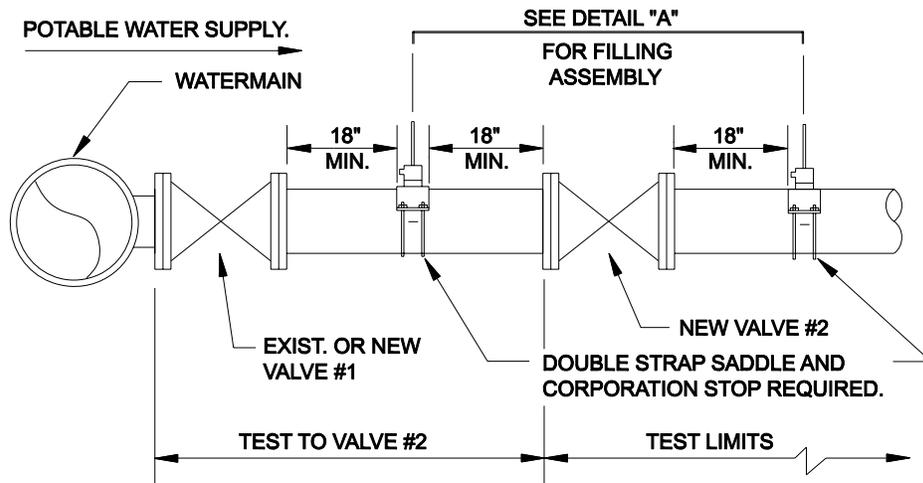

NOTES:

1. BOTH VALVES SHALL BE KEPT CLOSED EXCEPT FOR FILLING, FLUSHING, AND BACTERIOLOGICAL TESTING PURPOSES.
2. DEPARTMENT SHALL BE NOTIFIED BEFORE FILLING AND FLUSHING.
3. AFTER BACTERIOLOGICAL CLEARANCE, SECOND VALVE IS TO BE LEFT OPEN WITHOUT VALVE BOX.
4. PRESSURE TEST PUMP CONNECTS TO SERVICE LINE OR BLOWOFF. NO EXTRA TAPS ARE PERMITTED UNLESS PRECEEDING ARE NOT PRESENT IN TEST SECTION.
5. PRESSURE GAUGE TO BE LOCATED IN VICINITY OF TEST PUMP CONNECTION.
6. GAUGE AND RISER TO BE REMOVED AFTER PRESSURE TEST.
7. REMOVE TEMPORARY CONNECTION AT CORPORATION STOPS AFTER FILLING & FLUSHING HAS BEEN COMPLETED.
8. NEW VALVE MAY BE REMOVED AT S.L.C.U.'s OPTION.
9. INJECT CHLORINE ON PROJECT SIDE OF BACKFLOW PREVENTER.

LBPH INC. - CADD FILE NAME: L:\CAD-DETAILS\SLC\SLC-W15.DWG



**ST. LUCIE COUNTY
WATER & WASTEWATER
CONSTRUCTION STANDARDS**

**DOUBLE VALVE DETAIL &
FILLING AND FLUSHING
JUMPER CONNECTION FOR
SMALL DIAMETER PIPING**

DRAWING NUMBER: **W-15**