


2 1/2" BRASS NSFT
DISCHARGE WITH CAP
AND CHAIN

FLUSH HYDRANT BOX TO BE SUPPLIED BY CONTRACTOR
(POLYMER CONCRETE OR FIBER REINFORCED
POLYESTER.)

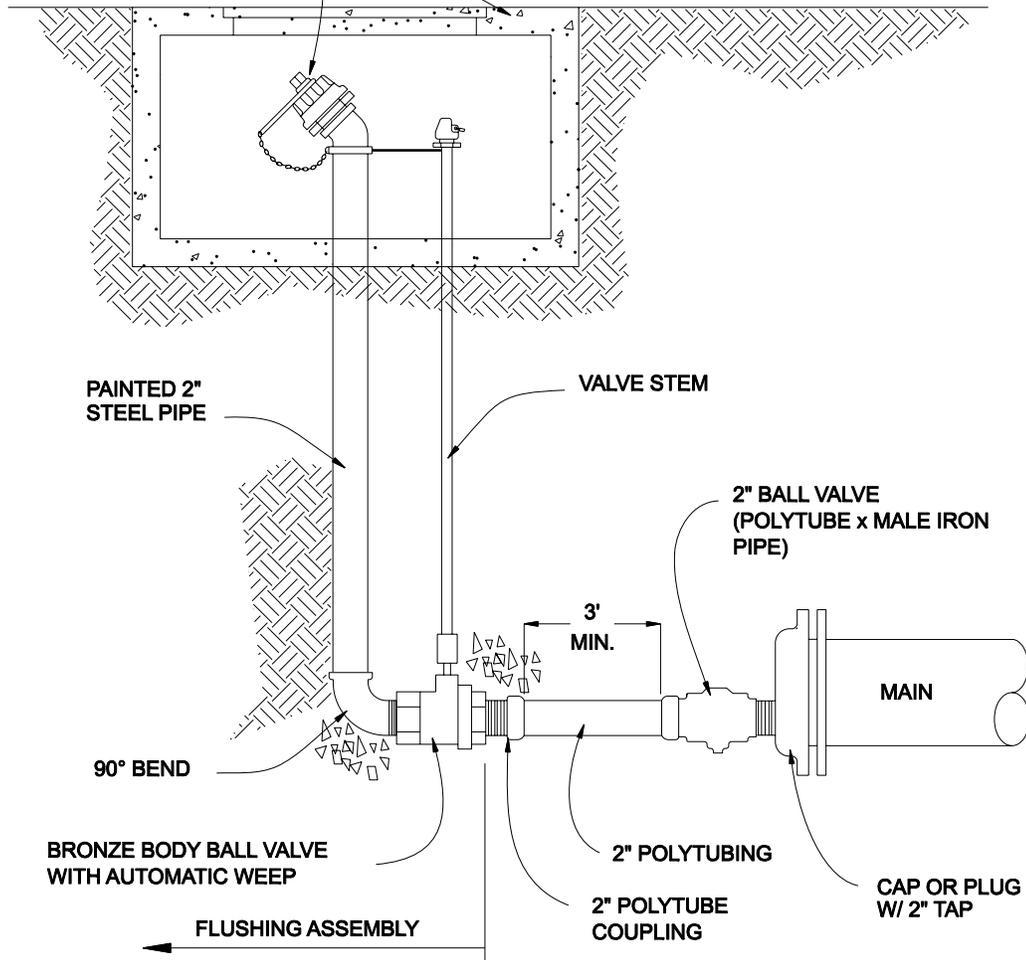

NOTES:

1. FLUSHING HYDRANT ASSEMBLY SHALL BE GIL INDUSTRIES, AQUARIUS ONE-O-ONE
2" POST FLUSHING HIDDEN HYDRANT.
2. MAIN TO BE RESTRAINED FOR TWO FULL LENGTHS.

LBFH INC. - CADD FILE NAME: L:\CAD-DETAILS\SLC\SLC-W7.DWG



ST. LUCIE COUNTY
WATER & WASTEWATER
CONSTRUCTION STANDARDS

FLUSHING HYDRANT/BLOWOFF

DRAWING NUMBER: **W-7**