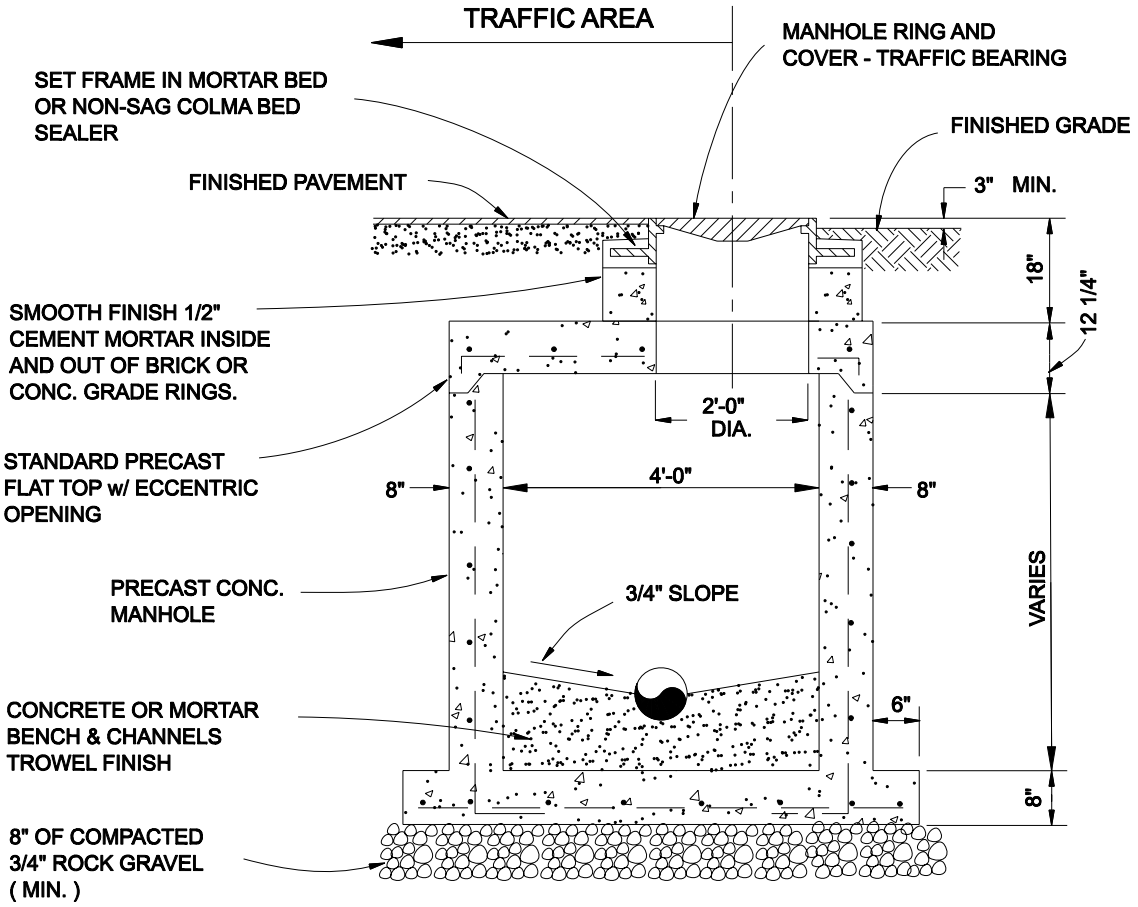

NOTES:

1. PROVIDE 0.1' DROP THROUGH MANHOLE EXCEPT ON STRAIGHT RUNS.
2. PRECAST CONCRETE MANHOLES SHALL CONFORM TO ASTM C478, SHALL BE TYPE II ACID RESISTANT CEMENT AND SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 4000 P.S.I. IN 28 DAYS.
3. USE ONLY WHERE APPROVED AND SPECIFIED ON PLANS.

LBFH INC. - CADD FILE NAME: L:/CAD-DETAILS/SLC/SLC-WW11.DWG

ST. LUCIE COUNTY
WATER & WASTEWATER
CONSTRUCTION STANDARDS

FLAT TOP
PRECAST MANHOLE

DRAWING NUMBER: WW-11