


5' X 5' X 5" THICK
 CONCRETE COLLAR
 WITH WIRE MESH
 REINFORCING.
 OR
 5' X 5' X 8" COLLAR
 WITHOUT REINFORCING.



PICK HOLE

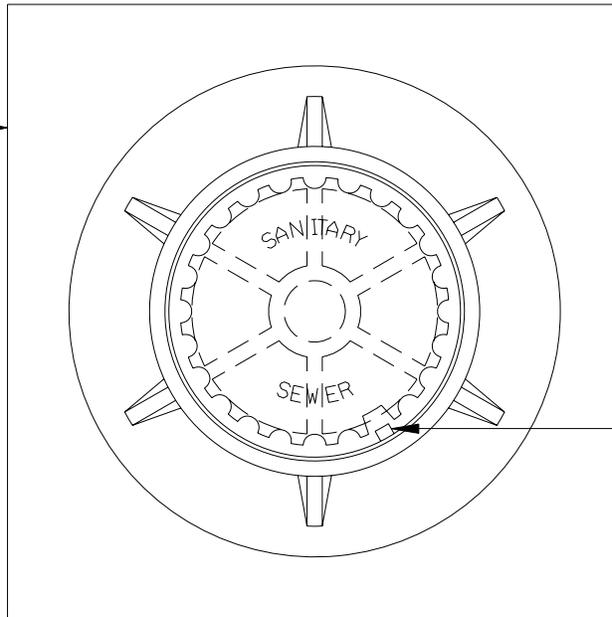

NOTES:

1. COLLAR IS REQUIRED ONLY WHEN MANHOLE IS OUT OF PAVEMENT.
2. MINIMUM WEIGHTS: COVER - 160 LBS., FRAME - 250 LBS.
3. FRAME AND COVER SHALL BE U.S. FOUNDRY NO. 410 OR VULCAN NO. 44 OR APPROVED EQUAL.
4. MANHOLE COVER SHALL HAVE THE WORDS "SANITARY SEWER" CAST IN METAL.

LBPH INC. - CADD FILE NAME: L:\CAD-DETAILS\SLC\WW-6.DWG



**ST. LUCIE COUNTY
 WATER & WASTEWATER
 CONSTRUCTION STANDARDS**

**SANITARY SEWER MANHOLE
 FRAME AND COVER**

DRAWING NUMBER: **WW-6**