


LBFH INC. - CADD FILE NAME: L:\CAD-DETAILS\SLC\SLC-WW8.DWG



NOTES:

1. ALL INVERT CHANNELS ARE TO BE CONSTRUCTED FOR SMOOTH FLOW WITHOUT OBSTRUCTION.
2. PROPERLY SHAPED SPILLWAYS SHALL BE CONSTRUCTED BETWEEN PIPES WITH DIFFERENT INVERT ELEVATIONS TO PROVIDE FOR SMOOTH FLOWS.
3. BRICK AND CONCRETE RUBBLE PERMITTED AS FLOW CHANNEL BUILDUP.
4. SIDEWALLS OF FLOW CHANNEL SHALL BE AT LEAST HALF OF PIPE HEIGHT AT ALL POINTS.

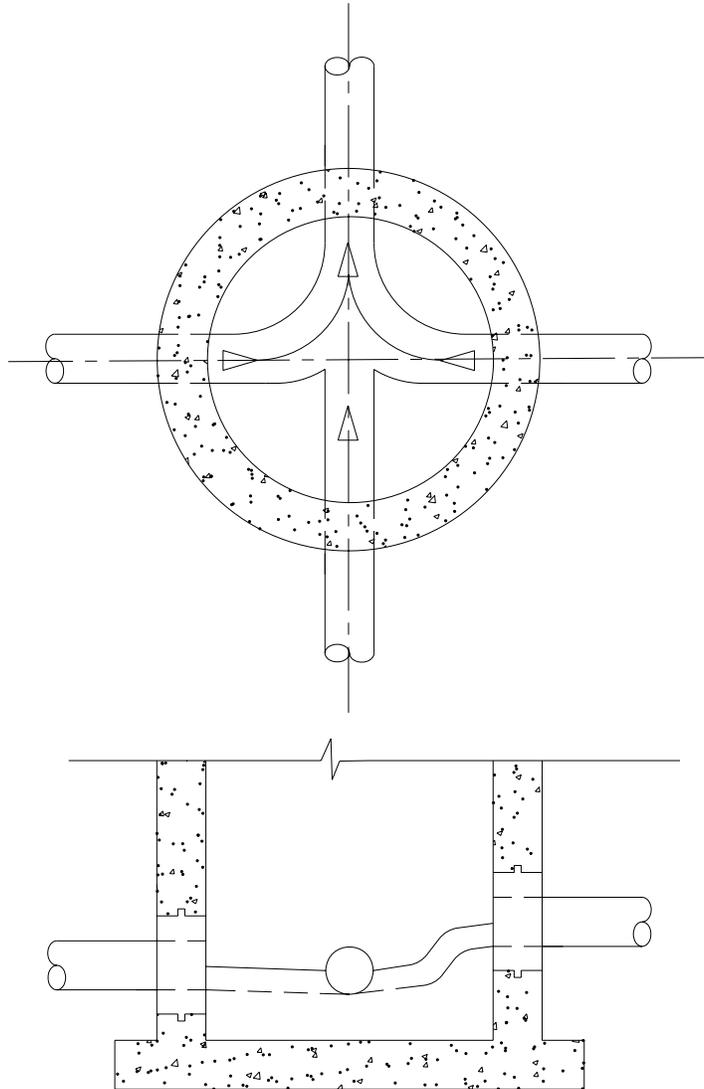

**ST. LUCIE COUNTY
WATER & WASTEWATER
CONSTRUCTION STANDARDS**

**INVERT FLOW
CHANNEL DETAIL**

DRAWING NUMBER: **WW-8**